

# Annexure C

## PROFORMA FOR SAFE DRINKING WATER AND SANITARY CONDITION CERTIFICATE

No. 059

Dated: 23/04/2025

It is certified that an inspection team headed by SUSHIL KUMAR (A.E.)

(Name of Officers with designation) from M.D.A., MEERUT PHED

inspected the G.D. GOENKA PUBLIC SCHOOL, KAILI, MEERUT - HAPUR ROAD,  
MEERUT

(Name & Address of the school) on 18/04/2025 (date of inspection) and on the basis of

Water Test Report (Attached) bearing no. TC 917522 0000000374F &  
TC 917522 0000000375F dated 23/04/2025

of NIR LABORATORY PVT LTD. (PHED Lab) certified that

the G.D. GOENKA PUBLIC SCHOOL (Name of school) has safe drinking water

facilities for the students and members of staff of the institution. School is also maintains the

hygienic sanitation condition in the school building & the campus as per norms prescribed by the

Central/ State/ U.T. Govt.

This certificate is valid till One year

Signature with Seal: सहायक अभियन्ता 23/04/2025

Name मेरठ विकास प्राधिकरण, मेरठ

Designation : .....

Name & Address of the Office / Department : .....

To  
G.D. GOENKA PUBLIC SCHOOL  
KAILI, MEERUT - HAPUR ROAD,  
(Name & Address of the Institution) MEERUT

Note: The certificate is to be issued by authorized officer / PHED Lab / local bodies

PRINCIPAL  
GD GOENKA PUBLIC SCHOOL

Shivansh




# NIR LABORATORY Pvt. Ltd.

(Formerly Known as Neon Industrial Testing & Research Laboratory)

NABL Accreditation Certificate TC-(9175), An ISO 9001 : 2015, ISO 14001 : 2015, ISO 45001 : 2018 Certified  
 Laboratory : 205 A-B, Rajpura, Mawana Road Near Subhash Inter College Meerut, www.nirlaboratory.in  
 Mobile : 8218221131, 8449335841, E-mail : nirlaboratory@gmail.com, neontrl@gmail.com

## TEST REPORT

SAMPLE CODE:		GW/NIR/20250418-01		PAGE		1 of 1
ULR: / NO.		TC9175220000000374F		SERVICE REQUEST DATE		18.04.2025
REPORT ISSUE DATE		23.04.2025		SAMPLE RECD. ON		18.04.2025
NAME & ADDRESS OF CUSTOMER				SAMPLE DETAILS		
M/S-GD Goenka Public School (A Unit Of G R R Educational And Social Welfare Trust) Kaili, Meerut 245 206				Description : One Ground water sample received us by client on 18.04.2025 Sample Marking : Ground water Sample Procedure : IS:3025 Sample Quantity & Packing: 1.5Ltr.& Plastic Bottle Analysis Done on : 18.04.2025 to 23.04.2025		
TEST RESULT				Standards limit (IS:10500-2012) Drinking water/ground water		
WATER QUALITY ANALYSIS						
S.No	Parameter	Result	Unit	Desirable Limit	Permissible Limit	Test method
1.	Turbidity	<1.0	NTU	1.0 max	5.0 max	IS:3025(P-10)
2.	pH	8.06	—	6.5-8.5	No Relaxation	IS:3025(P-11)
3.	Total Dissolved Solids	810	mg/l	500	2000	IS:3025(P-16)
4.	Total Hardness (as CaCO <sub>3</sub> )	444.0	mg/l	200	600	IS:3025(P-21)
5.	Calcium (as Ca)	91.2	mg/l	75	200	IS:3025(P-40)
6.	Chloride (as Cl)	184.9	mg/l	250	1000	IS:3025(P-32)
7.	Sulphate (as SO <sub>4</sub> )	38.3	mg/l	200	400	IS:3025(P-24)
8.	Total Alkalinity (asCaCO <sub>3</sub> )	226.0	mg/l	200	600	IS:3025(P-23)
9.	Fluoride (as F)	0.13	mg/l	1.0	1.5	IS: 3025(P-60)
10.	Electrical Conductivity	1598	µs/cm	Not Specified	Not Specified	IS: 3025(P-14)
11.	Iron (as Fe)	0.18	mg/l	0.3	No Relaxation	APHA 24 <sup>th</sup> Edidion-3500
12.	Magnesium (as Mg)	51.84	mg/l	30.0	100	IS: 3025(P-46)
13.	Nitrate (as NO <sub>3</sub> )	3.84	mg/l	45.0	No Relaxation	IS: 3025(P-34)
14.	Phosphate (as Po <sub>4</sub> )	0.27	mg/l	Not Specified	Not Specified	IS: 3025(P-31)
Microbiological / Bacteriological Tests:-						
15	E-Coli	Absent	Per/100ml	Shall Not Be Detectable in any 100 ml sample		IS:15185: 2016
16	Total Coliform	Absent	Per/100ml	Shall Not Be Detectable in any 100 ml sample		IS:15185: 2016

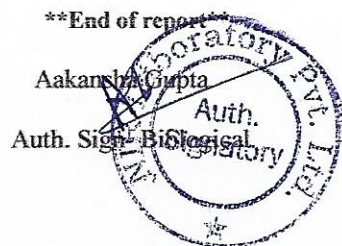

Note:- 1. The Sample will be stored up to 21 days (in case of non perishable items only) from the date of issue of the test report. 2. The results given above are related to the tested sample and mentioned parameters. Endorsement of Product if neither inferred nor implied. 3. Total liability of our works is limited to invoiced Amount. 4. This report can not used as evidence in a court of law without the written approval of the lab. 5. Certificate shall not be reproduced expect in full, without the written approval of the laboratory. 6. Any sort of play by the customer with the date of this certificate shall be illegal.



# NIR LABORATORY Pvt. Ltd.


(Formerly Known as Neon Industrial Testing & Research Laboratory)

NABL Accreditation Certificate TC-(9175), An ISO 9001 : 2015, ISO 14001 : 2015, ISO 45001 : 2018 Certified  
 Laboratory : 205 A-B, Rajpura, Mawana Road Near Subhash Inter College Meerut, www.nirlaboratory.in  
 Mobile : 8218221131, 8449335841, E-mail : nirlaboratory@gmail.com, neonitr@gmail.com

## TEST REPORT

SAMPLE CODE:		GW/NIR/20250418-02		PAGE		1 of 1
ULR: / NO.		TC9175220000000375F		SERVICE REQUEST DATE		18.04.2025
REPORT ISSUE DATE		23.04.2025		SAMPLE RECD. ON		18.04.2025
NAME & ADDRESS OF CUSTOMER				SAMPLE DETAILS		
M/S- GD Goenka Public School (A Unit Of G R R Educational And Social Welfare Trust) Kaili, Meerut 245 206				Description : One RO water sample received us by client on 18.04.2025 Sample Marking : RO water Sample Procedure : IS:3025 Sample Quantity & Packing: 1.5Ltr.& Plastic Bottle Analysis Done on : 18.04.2025 to 23.04.2025		
TEST RESULT				Standards (IS:10500-2012) Drinking water/ground water		
WATER QUALITY ANALYSIS				limit		
S.No	Parameter	Result	Unit	Desirable. Limit	Permissible. Limit	Test method
1.	Turbidity	<1.0	NTU	1.0 max	5.0 max	IS:3025(P-10)
2.	pH	7.98	—	6.5-8.5	No Relaxation	IS:3025(P-11)
3.	Total Dissolved Solids	182	mg/l	500	2000	IS:3025(P-16)
4.	Total Hardness (as CaCO <sub>3</sub> )	96.0	mg/l	200	600	IS:3025(P-21)
5.	Calcium (as Ca)	27.2	mg/l	75	200	IS:3025(P-40)
6.	Chloride (as Cl)	54.9	mg/l	250	1000	IS:3025(P-32)
7.	Sulphate (as SO <sub>4</sub> )	14.80	mg/l	200	400	IS:3025(P-24)
8.	Total Alkalinity (asCaCO <sub>3</sub> )	60.0	mg/l	200	600	IS:3025(P-23)
9.	Fluoride (as F)	0.08	mg/l	1.0	1.5	IS: 3025(P-60)
10.	Electrical Conductivity	362.0	µs/cm	Not Specified	Not Specified	IS: 3025(P-14)
11.	Iron (as Fe)	0.11	mg/l	0.3	No Relaxation	APHA 24 <sup>th</sup> Edidion-3500
12.	Magnesium (as Mg)	6.72	mg/l	30.0	100	IS: 3025(P-46)
13.	Nitrate (as NO <sub>3</sub> )	1.24	mg/l	45.0	No Relaxation	IS: 3025(P-34)
14.	Phosphate (as Po <sub>4</sub> )	0.16	mg/l	Not Specified	Not Specified	IS: 3025(P-31)
Microbiological / Bacteriological Tests:-						
15	E-Coli	Absent	Per/100ml	Shall Not Be Detectable in any 100 ml sample		IS:15185: 2016
16	Total Coliform	Absent	Per/100ml	Shall Not Be Detectable in any 100 ml sample		IS:15185: 2016

\*\*End of report\*\*

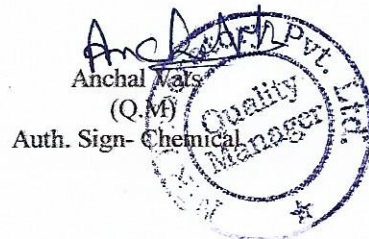

Note:- 1. The Sample will be stored up to 21 days (in case of non perishable items only) from the date of issue of the test report. 2. The results given above are related to the tested sample and mentioned parameters. Endorsement of Product if neither inferred nor implied. 3. Total liability of our works is limited to invoiced Amount. 4. This report can not used as evidence in a court of law without the written approval of the lab. 5. Certificate shall not be reproduced except in full, without the written approval of the laboratory. 6. Any sort of play by the customer with the date of this certificate shall be illegal.